


MODULAR CYLINDER

Description

Clean Agent Fire Extinguishing System listed by UL (Underwriters Laboratories) and approved by FM (Factory Mutual), composed by a modular cylinder filled with HFC-227ea (FM-200) and over-pressurized with nitrogen (IG-100) at 360, 464, 493, 610, 725 and 798 psi (25, 32, 34, 42, 50 and 55 bar).

Scheme

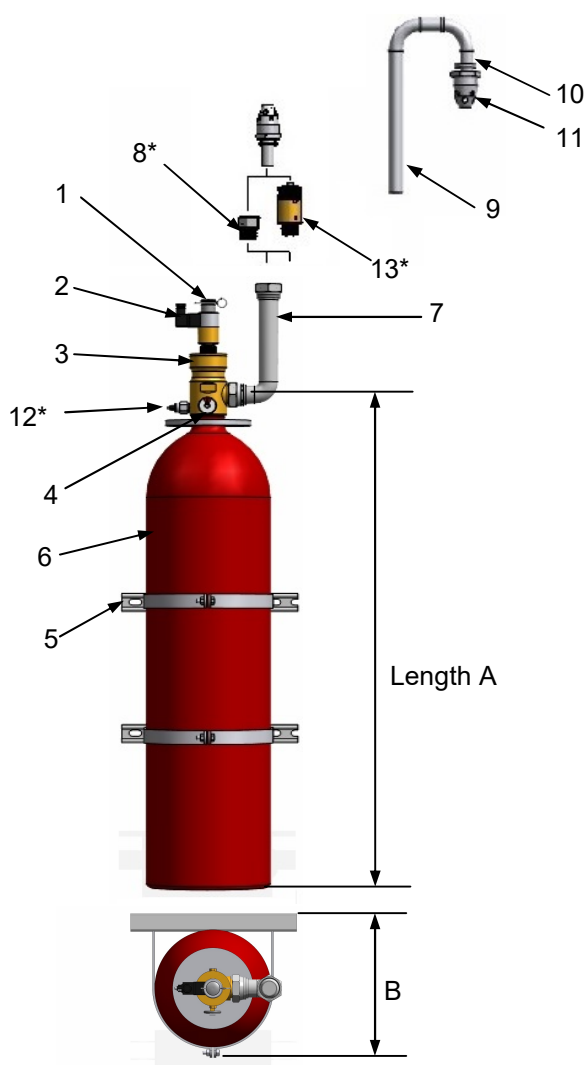

Technical information

Item	Description	Quantity	Part number
1	Manual actuator	1	227DM / 227DMS
2	Electrical actuator	1	227SOL / 227SOLC
3	Container valve	1	RGS-MAM-11/12/20/40/50/80
4	Pressure gauge	1	UF40H-P25 / UF40H-P32 / UF40H-P34 / UF40H-P42 / UF40H-P50 / UF40H-P55
5	Brackets	-	POHCxxx
6	Cylinder	1	227MXXXUFX-X
7	Discharge hose	1	DH15 / DH15I / DH16 / DH16I / DH20 / DH20I / DH21 / DH21I / FH-15COUF / FH-20HC / FH-25HC / FH-40HC / FH-50HC / FH-80HC / FH-80HC34
8*	Adapter	1	POADxxMH
9	Discharge pipe	1	-
10	Discharge nozzle	1	FEDRxx
11	Calibrated plate	1	POPCxx
12	Pressure switch	1	POPRENxx / POPRENCxx
13*	Check valve	1	VALAN-15CO / VALAN-20A / VALAN-21A / VALAN-40-23 / VALAN-50-125 / VALAN-80

*These accessories are optional.